





# VIBRATION MANAGEMENT CORPORATION

3532-A EAST TC JESTER , BROOKWOOD BUSINESS PARK , HOUSTON , TEXAS 77018 , U.S.A

INTERNET ADDRESS: [www.vimco.biz](http://www.vimco.biz)



Not applicable with booster springs

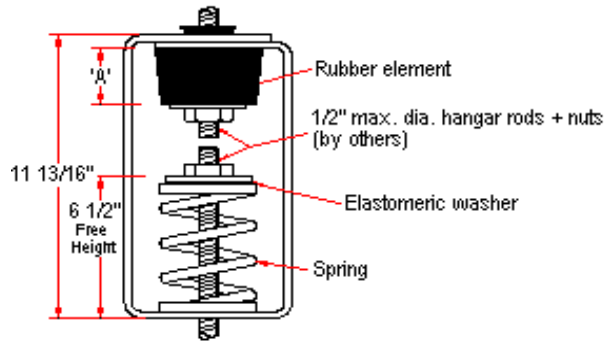

N.T.S.

ISOLATOR MODEL	RATED LOAD (lbs)	SOLID LOAD (lbs)	'A' (inches)
HNSE-A4-181	86	130	1 1/4
HNSE-B1-182	133	200	1 3/4
HNSE-B2-183	180	270	1 3/4
HNSE-B3-184	266	400	1 3/4
HNSE-C3-185	486	730	3
HNSE-C4-186	713	1070	3
HNSE-C4-187	926	1390	3
HNSE-C3-181-199	593	890	3
HNSE-C4-182-199	633	950	3
HNSE-C4-183-199	683	1025	3
HNSE-C4-184-199	783	1175	3
HNSE-C4-185-199	933	1400	3
HNSE-D2-186-199	1233	1850	3
HNSE-D2-187-199	1460	2190	3

### FEATURES

- \* Load distribution steel washer
- \* Embedded steel plates in rubber element for uniform loading.
- \* Oil + water resistant rubber element
- \* High deflection, low natural frequency
- \* Spring / Rubber elements color-coded for easy field verification  
(*Rubber element color coding can be by 'dot' or 'complete element'*)
- \* Rubber element incorporates projected collar to prevent metal to metal contact between rod and bracket.

### NOTES

1. Springs have 50% additional travel to solid beyond rated load.
2. Isolators should be selected in the range of -30% to +25% of rated load.
3. Consult spring chart for isolator performance data.
4. Contact factory for optional drilling to accept larger hanger rod sizes.

Notes / Remarks :

Project :  
Client :  
Consultant :  
Representative :

Title :

**HNSE**  
**Neo-Spring™ Hanger**  
**(3.5" deflection)**

Drawing no.  
**S-2400.21**

Rev. 1